




AREA OF WORK (ENCOMPASSED BY GREEN RECTANGLE)
REMOVE ALL 3/4" PLYWOOD SUB FLOORING AND EPOXY
COATING DOWN TO METAL DESK. REMOVE ALL FASTENERS

REMOVE EXISTING - EAST - WEST WALL IN ENTIRITY

NEW OFFICES TYPICAL OF 8 (EACH OFFICE
APPROX 10' X 15' - FIELD VERIFY)

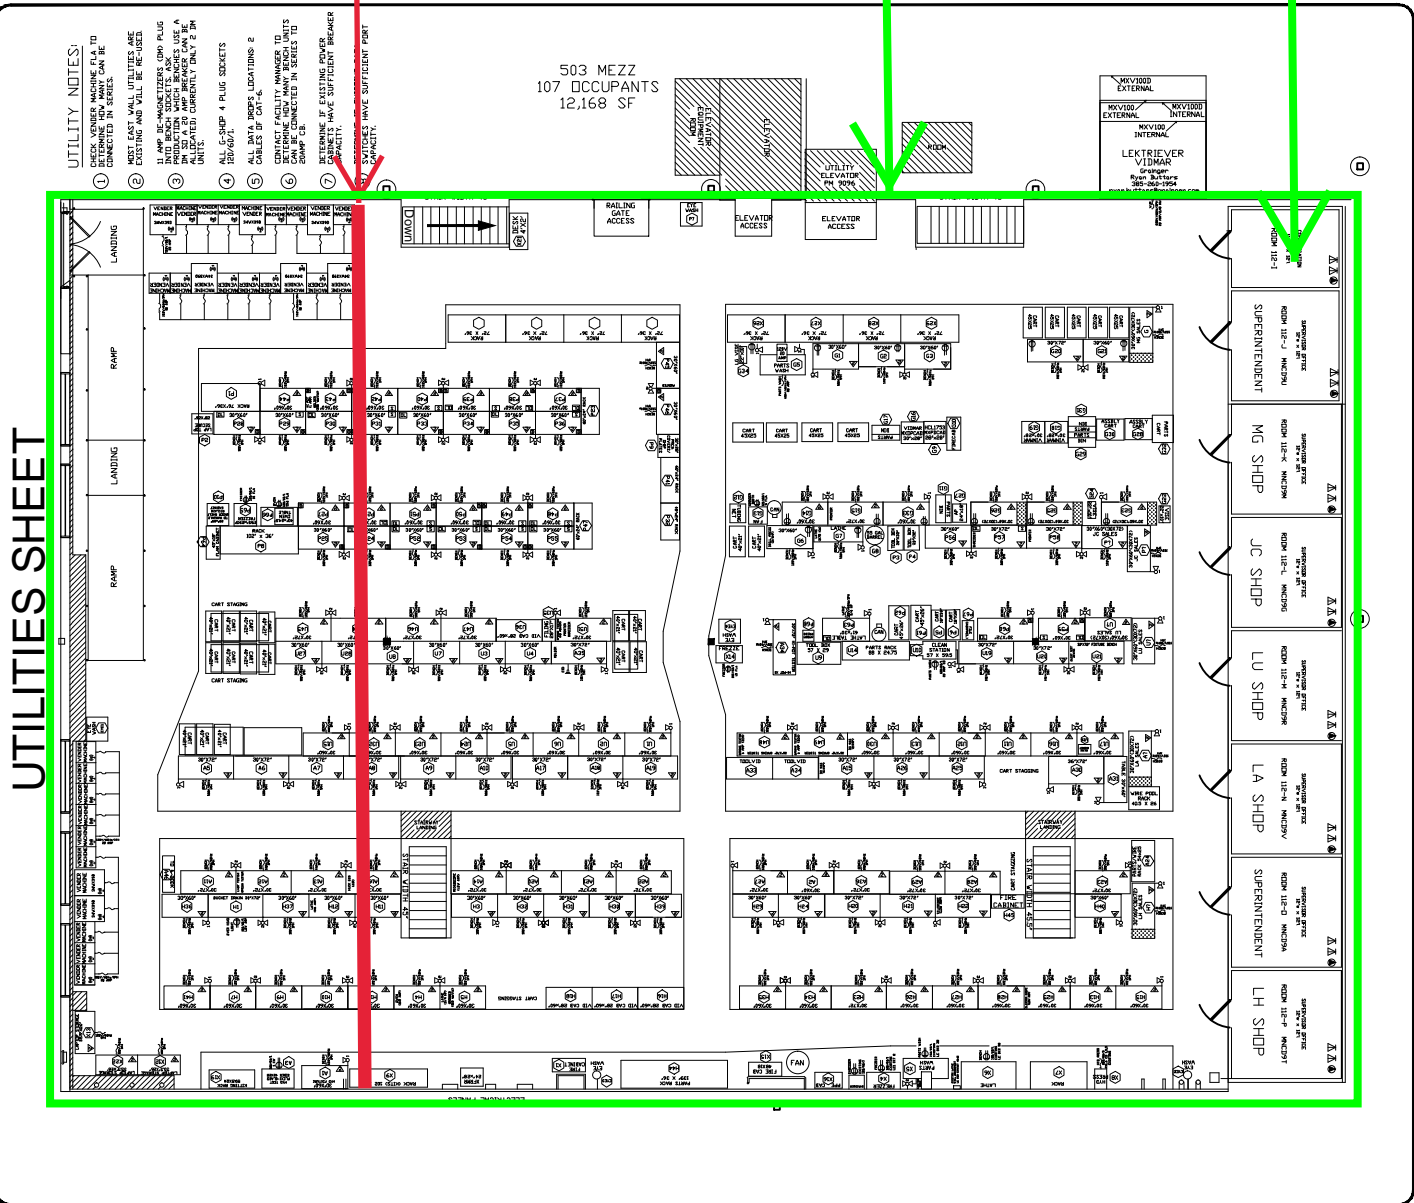

- UTILITY NOTES:
1. ALL CONDUIT SHALL BE CONNECTED IN SERIES.
 2. MOST EAST WALL UTILITIES ARE EXISTING AND WILL BE RE-USED.
 3. ALL RAMP ASSEMBLIES, CONDUIT PLUGS, AND RACEWAYS SHALL BE REMOVED. ALL RACEWAYS SHALL BE REMOVED CURRENTLY ONLY 2 IN DIA. ONLY.
 4. ALL 6-3/8" RAMP 4 PLUG SOCKETS SHALL BE REMOVED.
 5. ALL DATA WIRE LOCATIONS SHALL BE IDENTIFIED BY DATE.
 6. CONTACT FACILITY MANAGER TO OBTAIN INFORMATION ON EXISTING UTILITIES AND RAMP CB.
 7. DETERMINE IF EXISTING POWER RACEWAYS HAVE SUFFICIENT BREAKER CAPACITY.
 8. ALL UTILITIES HAVE SUFFICIENT PORT CAPACITY.



DATE	TYPE

LOGGED IN

LOGGED OUT

DATE

TIME

BY

USER

LOGGED IN

LOGGED OUT

DATE

TIME

BY

USER

LOGGED IN

LOGGED OUT

DATE

TIME

BY

USER

BLDG. 503 MEZZ UTILITY

531ST SHOP FLOOR MOVE PLANS