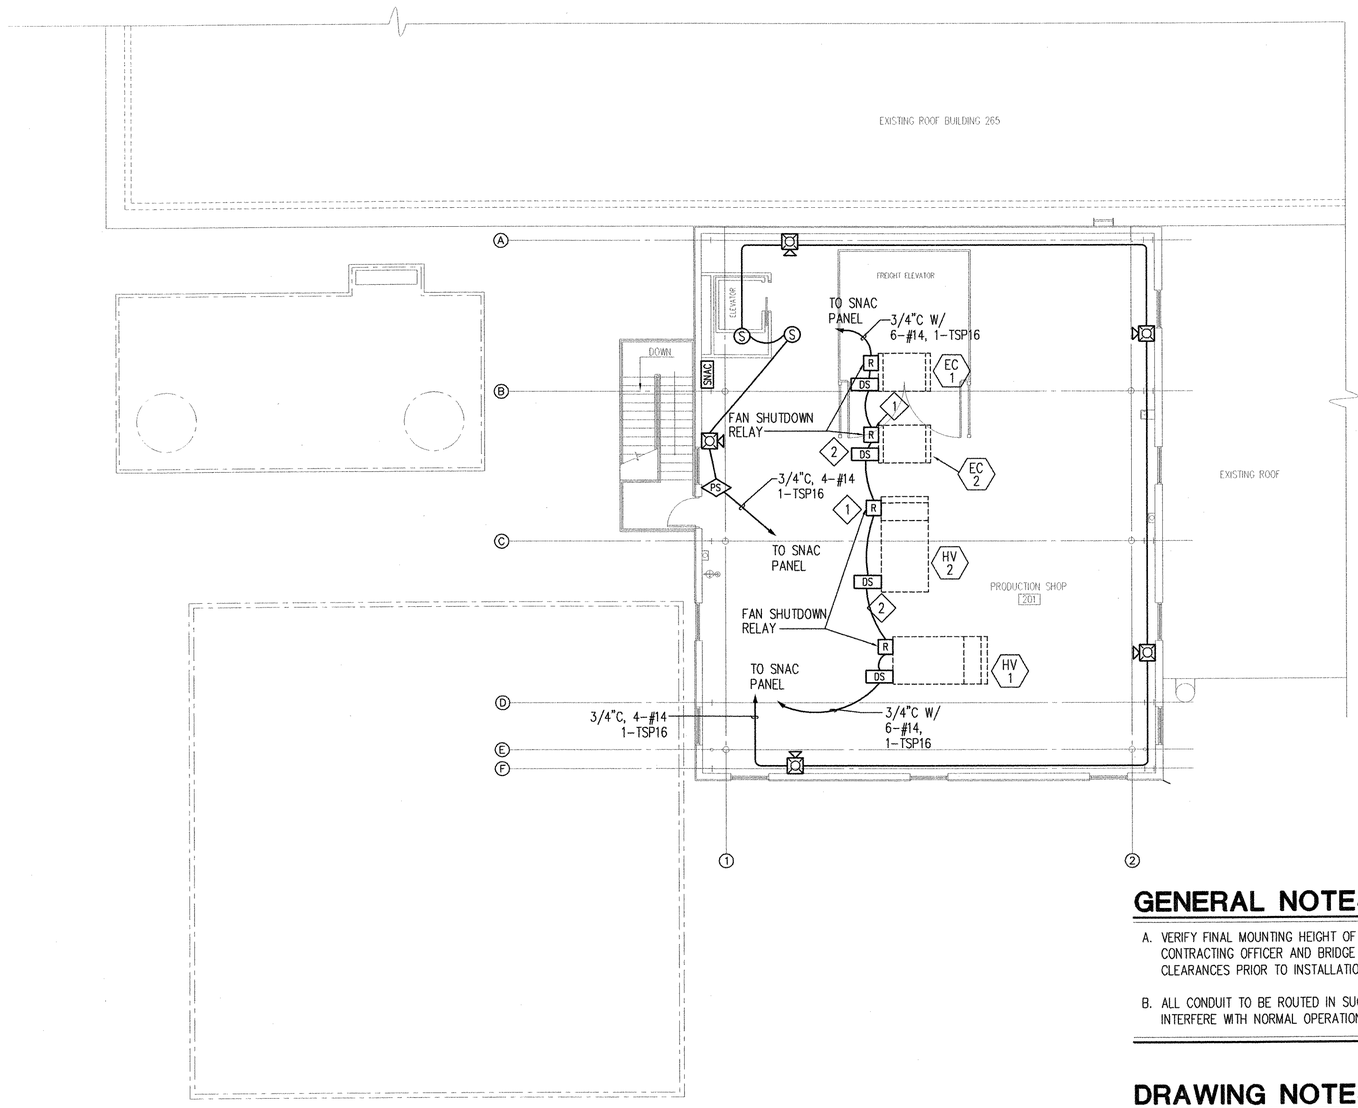

SECOND FLOOR FIRE ALARM PLAN

SCALE: 1/8"=1'-0"

10 5 0 10 20

GENERAL NOTES

A. VERIFY FINAL MOUNTING HEIGHT OF ALL FIXTURES WITH CONTRACTING OFFICER AND BRIDGE CRANE INSTALLERS FOR CLEARANCES PRIOR TO INSTALLATION OF FIXTURES.

B. ALL CONDUIT TO BE ROUTED IN SUCH FASHION AS TO NOT INTERFERE WITH NORMAL OPERATION OF BRIDGE CRANE.

DRAWING NOTES

1. CONNECTION TO FUTURE UNIT. NOT IN CONTRACT. PROVIDE J-BOX.
2. FUTURE DUCT SMOKE DETECTOR, PROVIDE J-BOX FOR FUTURE CONNECTION.

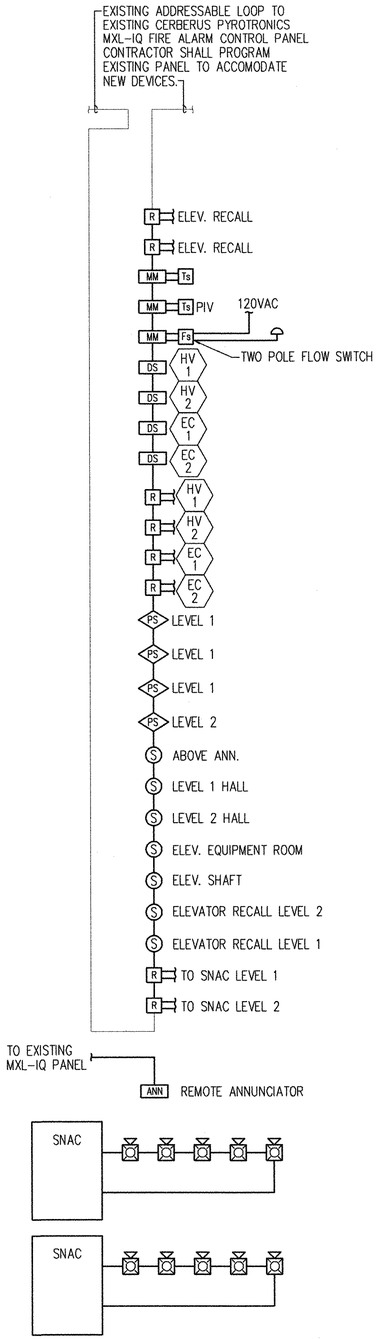

FIRE ALARM RISER SCHEMATIC

SCALE: NONE

LICENSED PROFESSIONAL ENGINEER No. 328126 NOLAN E. JOHNSON STATE OF UTAH

DESCRIPTION	DATE	APPR	MARK

DESIGNED BY: A. KILPATRICK
DRAWN BY: A. HOWELL
CHECKED BY: N. JOHNSON
PROJECT NUMBER: KRSM 052030
GOVERNMENT REVIEWER: -

HILL AIR FORCE BASE
DEPARTMENT OF THE AIR FORCE
OGDEN AIR LOGISTICS CENTER
775TH CIVIL ENGINEERING SQUADRON

CONSTRUCT 2 STORY ADDITION
EAST SIDE BUILDING 265

SECOND FLOOR FIRE ALARM PLAN

E-106

SHEET 51 OF 54