



Bay1 7929



Bay1 7930



Bay1 7931



Bay1 7932



Bay1 7933



Bay1 7934



Bay1 7935



Bay1 7936



Bay1 7937



Bay1-2 7928



Bay1-2 7946



Bay2 7920



Bay2 7921



Bay2 7922



Bay2 7923



Bay2 7924



Bay2 7925



Bay2 7926



Bay2 7927



Bay2 7939



Bay2 7940



Bay2 7941



Bay2 7942



Bay2-3 7938



Bay2-3 7943



Bay3 7918



Bay4 7944



Bay4-5 7919



Bay5 FA1



Bay5 FA2



Bay5 FA3



Bay5 FA4



Bay7-8 7945



Ext XFMRs 7947



Ext XFMRs 7948






09 MXSS
Radiographic Computer
Tomography
321 Lemon Lane

DANGER
X-RAYS ON
WHEN LIGHT
IS ON


Bay
4

Bay
5

DANGER
X-RAYS ON
WHEN LIGHT IS ON

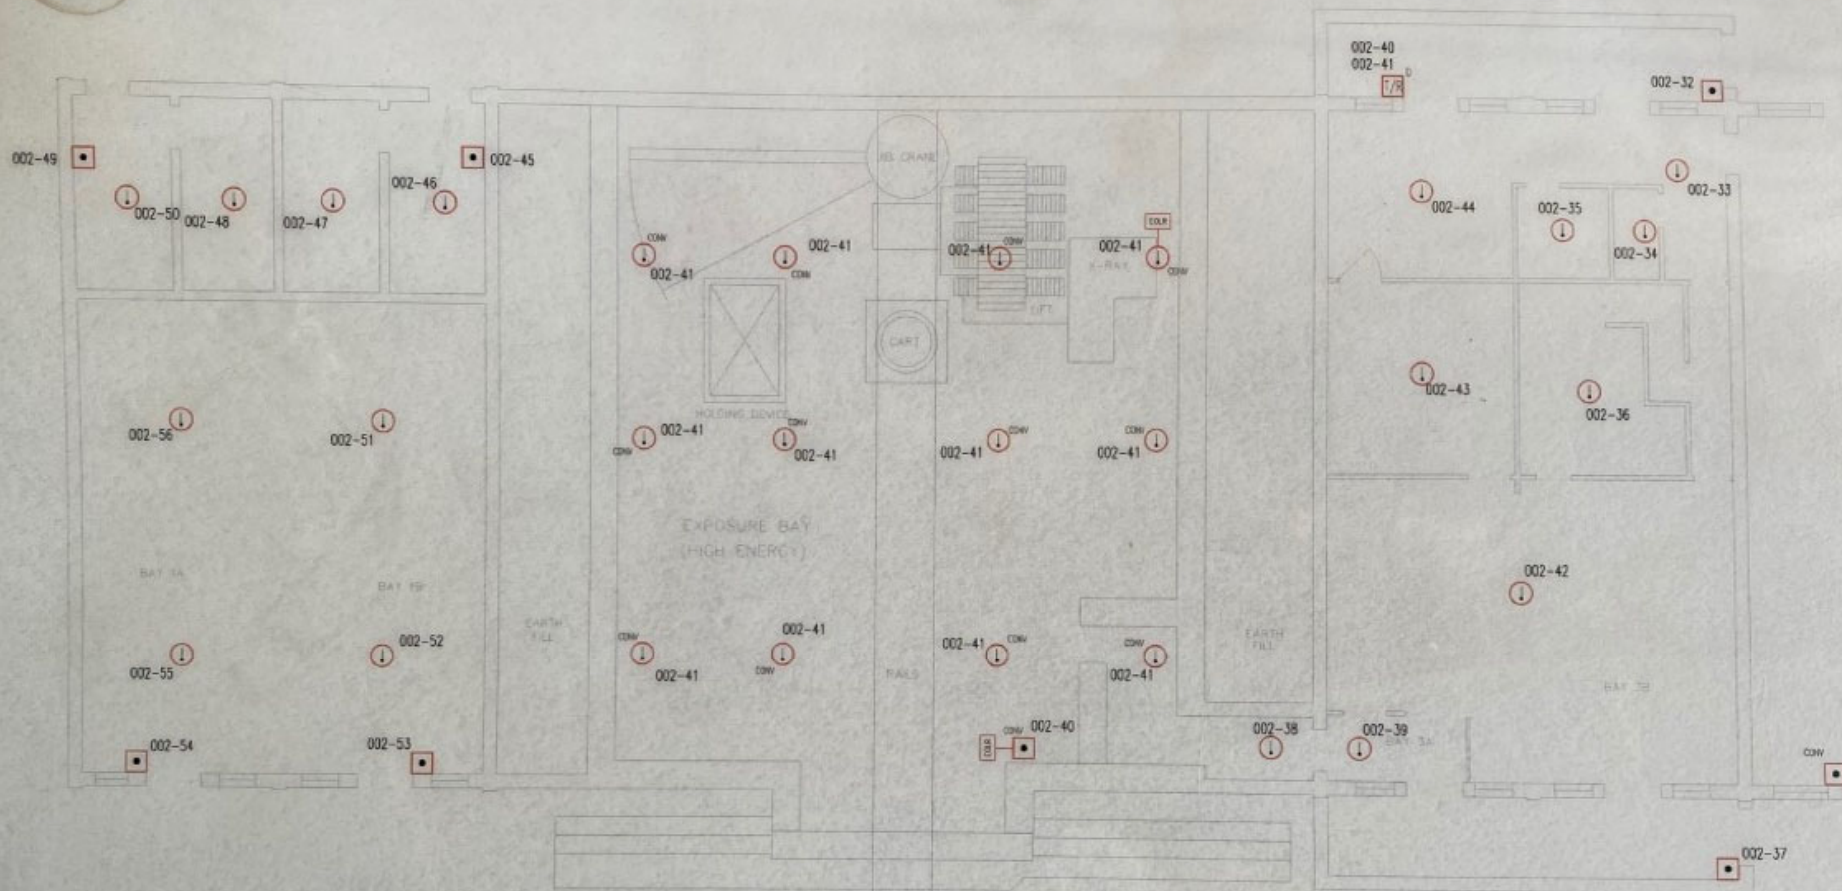


BUILDING 2113 FIRE ALARM KEYZONES
BAYS 1, 2, & 3



LEGEND & DESCRIPTION			
SYM	DESCRIPTION	SYM	DESCRIPTION
	FIRE ALARM CONTROL PANEL		MONITOR MODULE
	NAC POWER SUPPLY		RELAY MODULE
	MONACO SYSTEM		DUAL MONITOR MODULE
	INTELLIGENT SMOKE DETECTOR		DUCT DETECTOR
	INTELLIGENT HEAT DETECTOR		MONITOR MODULE
	MANUAL PULL STATION		MONITOR MODULE
	HEAT DETECTOR CONVENTIONAL		MONITOR MODULE
	PULL STATION CONVENTIONAL		MONITOR MODULE
			MONITOR MODULE


SIEMENS Fire Safety
Siemens Building Technologies, Inc.

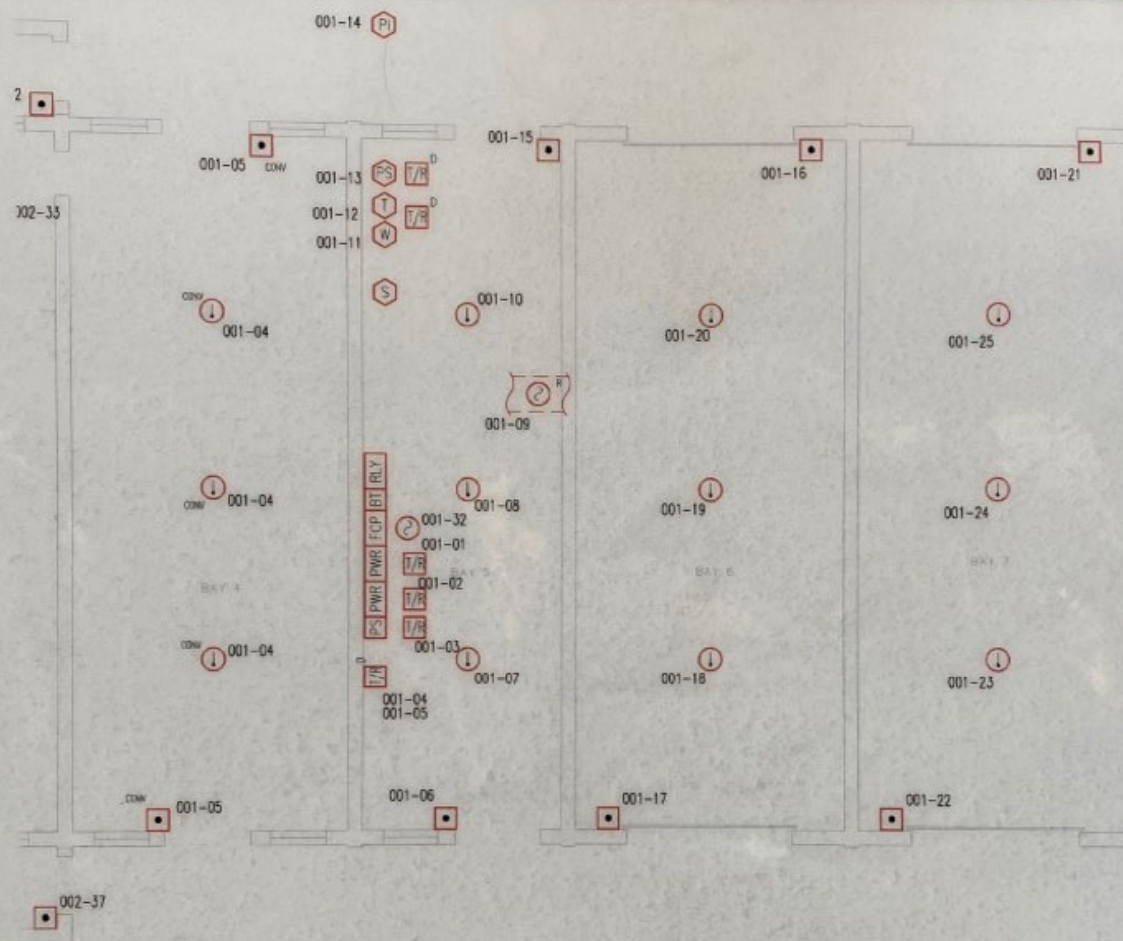


LEGEND & DESCRIPTION				
SYM	DESCRIPTION		SYM	DESCRIPTION
[FCP]	FIRE ALARM CONTROL PANEL	MXL	[TR-S]	MONITOR MODULE
[PWR]	NAC POWER SUPPLY	PAO-3	[TR-R]	RELAY MODULE
[BT]	MONACO SYSTEM	BT2-8	[TR-D]	DUAL MONITOR MODULE
[2]	INTELLIGENT SMOKE DETECTOR	FP-11	[AD-11XPR/FP-11]	DUCT DETECTOR
[1]	INTELLIGENT HEAT DETECTOR	FP-11	[M]	MONITOR MODULE
[M]	MANUAL PULL STATION	MSM-KD/TRI-BEM	[S]	MONITOR MODULE
[CONV]	HEAT DETECTOR CONVENTIONAL	DT-135	[R]	MONITOR MODULE
[CONV]	PULL STATION CONVENTIONAL	MSM-KD	[PS]	MONITOR MODULE

BUILDING 2113 FIRE ALARM KEYZONES

BAYS 4, 5, 6, & 7




SIEMENS Fire Safety
Siemens Building Technologies, Inc.

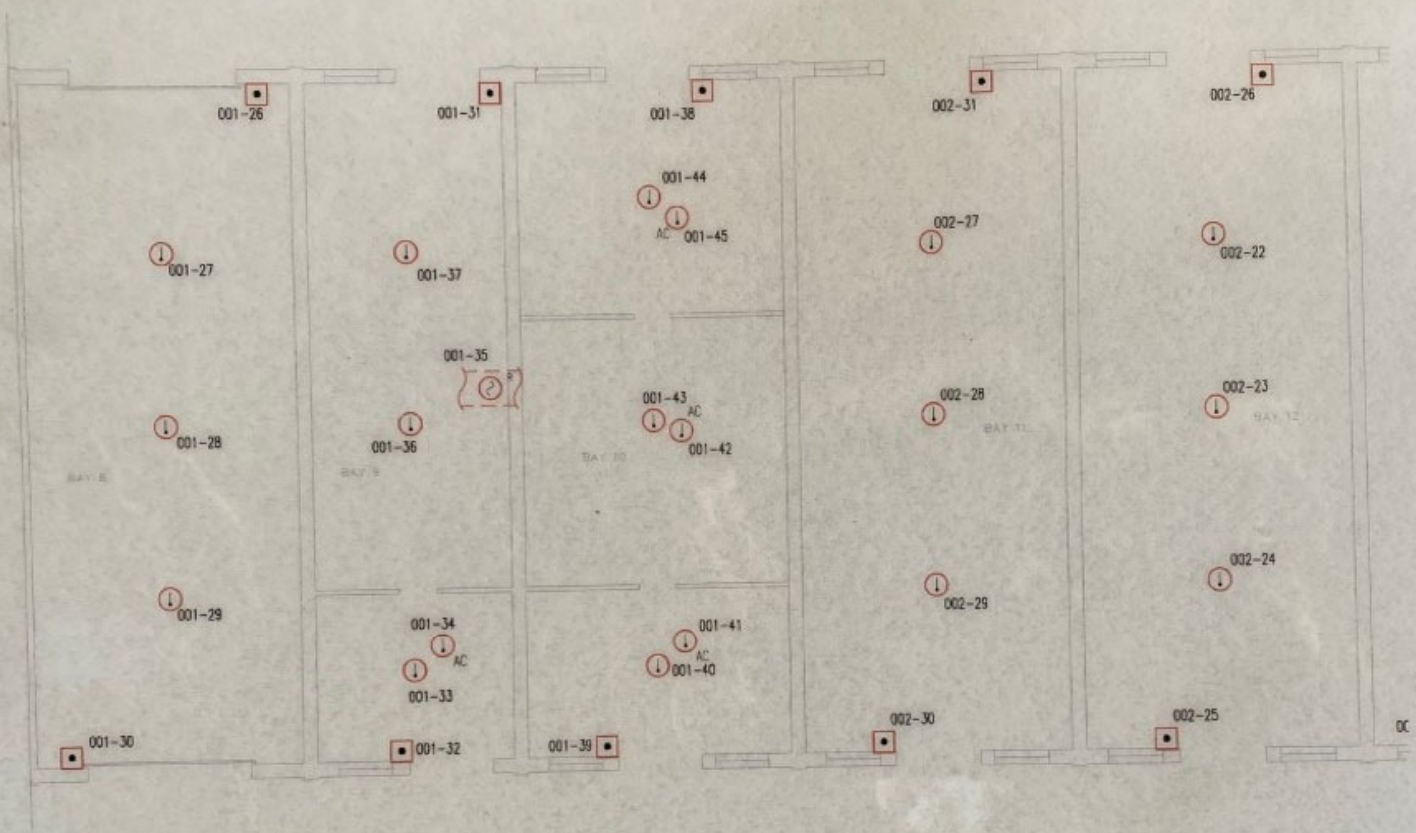


LEGEND & DESCRIPTION

SYM	DESCRIPTION	SYM	DESCRIPTION
	FIRE ALARM CONTROL PANEL		MONITOR MODULE
	NAC POWER SUPPLY		RELAY MODULE
	MONACO SYSTEM		DUAL MONITOR MODULE
	INTELLIGENT SMOKE DETECTOR		DUCT DETECTOR
	INTELLIGENT HEAT DETECTOR		MONITOR MODULE
	INTELLIGENT HEAT ABOVE CEILING		MONITOR MODULE
	MANUAL PULL STATION		MONITOR MODULE
	HEAT DETECTOR CONVENTIONAL		MONITOR MODULE
	PULL STATION CONVENTIONAL		MONITOR MODULE

BUILDING 2113 FIRE ALARM KEYZONES BAYS 8, 9, 10, 11, & 12




SIEMENS Fire Safety
Siemens Building Technologies, Inc.

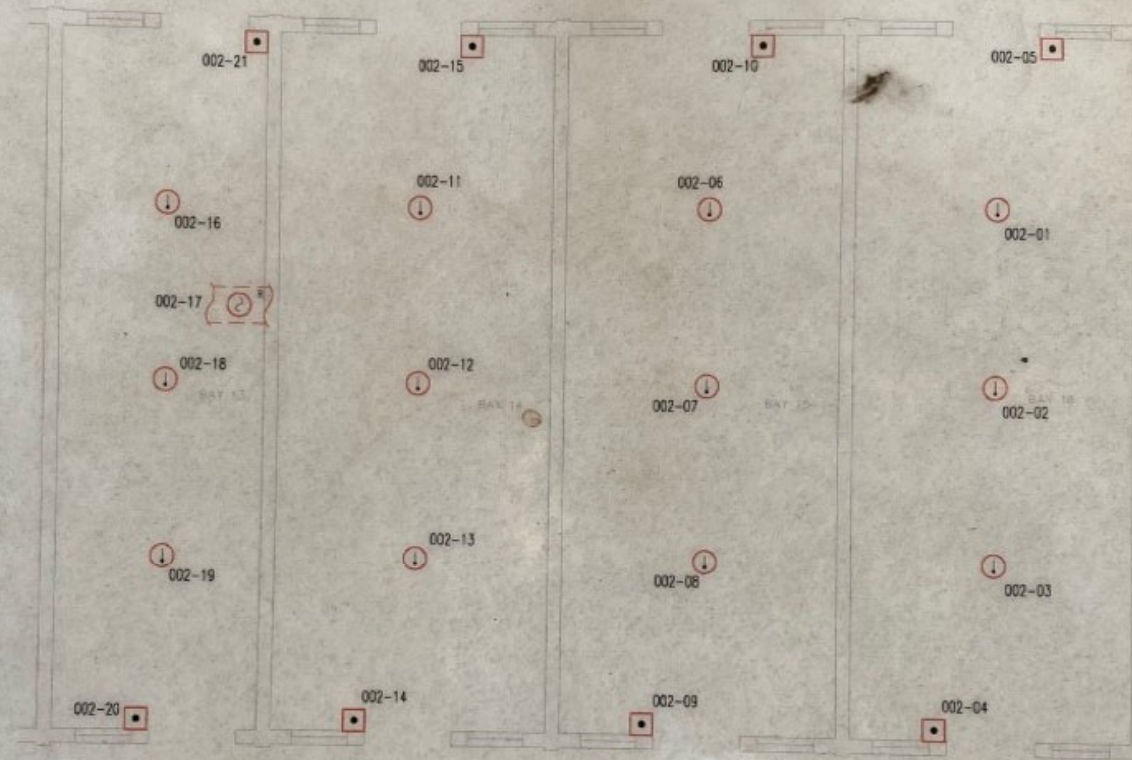

LEGEND & DESCRIPTION				
SYM	DESCRIPTION		SYM	DESCRIPTION
[FAP]	FIRE ALARM CONTROL PANEL	MXL	[M]	MONITOR MODULE
[PWS]	NAC POWER SUPPLY	PAO-3	[R]	RELAY MODULE
[BT]	MONACO SYSTEM	BT2-8	[DM]	DUAL MONITOR MODULE
[ISD]	INTELLIGENT SMOKE DETECTOR	FP-11	[DD]	DUCT DETECTOR
[IHD]	INTELLIGENT HEAT DETECTOR	FPT-11		AD-11XPR/FP-11
[MPS]	MANUAL PULL STATION	MSM-KD/TRI-BSM	[M]	MONITOR MODULE
[HDC]	HEAT DETECTOR CONVENTIONAL	DT-135	[M]	MONITOR MODULE
[PSC]	PULL STATION CONVENTIONAL	MSM-KD	[M]	MONITOR MODULE
			[M]	MONITOR MODULE

BUILDING 2113 FIRE ALARM KEYZONES

BAYS 13, 14, 15, & 16









2113





2113

Bay
1



2113









CLEAN WASH BOWLS
AFTER USING

EXIT

CAUTION
RADIATION AREA







2113

Bay
1



CAUTION
EXCAVATION AREA



**CAUTION
RADIATION AREA**



DANGER
RADIATION AREA
WHEN LIGHT OR
BOMB IS OPERATING

CAUTION
RADIATION AREA



CAUTION
CHECK WITH
RADIOGRAPHIC
OPERATOR BEFORE
USING LADDER

CAUTION
RADIATION
AREA









**CAUTION
RADIATION AREA**









DANGER
RADIATION AREA
WHEN LIGHT OR
HORN IS OPERATING





**CAUTION
RADIATION AREA**



DANGER
RADIATION AREA
DO NOT ENTER OR
WORK IN OPERATING





Bay
2

CAUTION
RADIATION AREA



CAUTION
RADIATION AREA



UTION
UTION AREA

809 MXSS
Radiographic Computer
Tomography
6321 Lemon Lane

DANGER
X-RAYS ON
WHEN LIGHT
IS ON